




Wiring Diagram

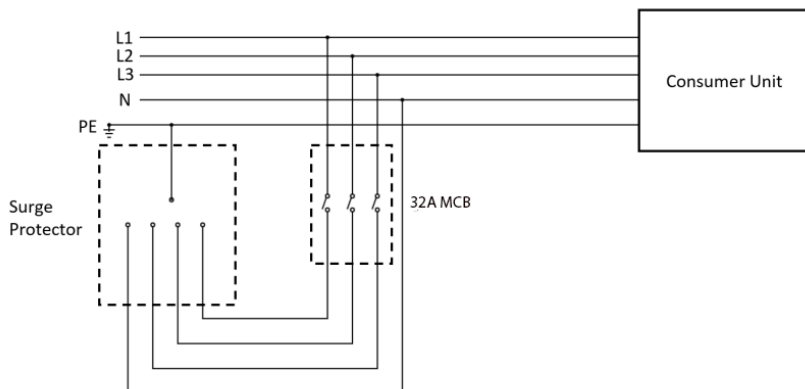

Technical Specification


Enclosure	ABS
Protected Poles	3P+N 230/400V
MAX AC. Operating Voltage	275VAC
AC System	TT-TN
Nominal Discharge	5kA
Max. Discharge	15kA
Temporary Overvoltage 5s	335VAC Withstand
Voltage Protection Level	0.9kV
Conductor Size	1.5 - 10mm(L/N) 2.5 - 25mm(E)
Standards	18th Edition Compliant IEC 61643-11, EN 5053911
Recommended Fuse Protection	32A MCB Included 20A - 125A
Surge Protection Torque	1.2 - 1.5Nm(L/N) 2 - 2.5Nm(E)
MCB Torque	2Nm

The EPSPD15-32MCB3P is only to be installed by a Qualified electrician and must conform with the latest edition of the IEC Wiring Regulations for Electrical Installations BS7671.

Installation Guide

1. Loosen the screws and remove the front cover of the EPSPD
2. Mount the EPSPD to the wall at the 3 screw locations
3. Ensure MCB is in the off position
4. Feed incoming live mains cables into the bottom of the MCB, Neutral cable required into the top of the Surge Protection
5. Refer to Torque Settings to ensure correctly tightened
6. Refit front cover

Dimensions

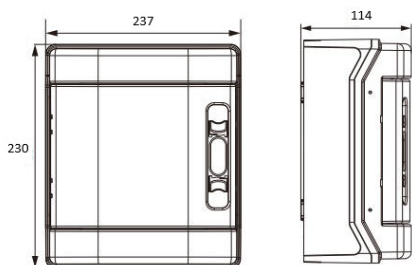

When indicator shows red, please replace cartridge

Once installation is complete the device must be tested in accordance with IEC Wiring Regulations for Electrical Installations BS7671.